




SECTION "A-A"  
NO SCALE

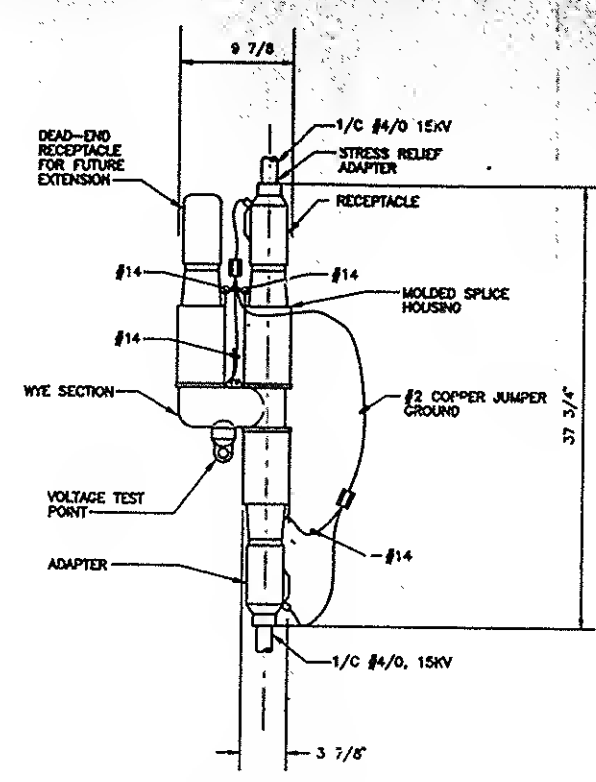

15KV-WYE SPLICE  
(TYPICAL)  
NO SCALE

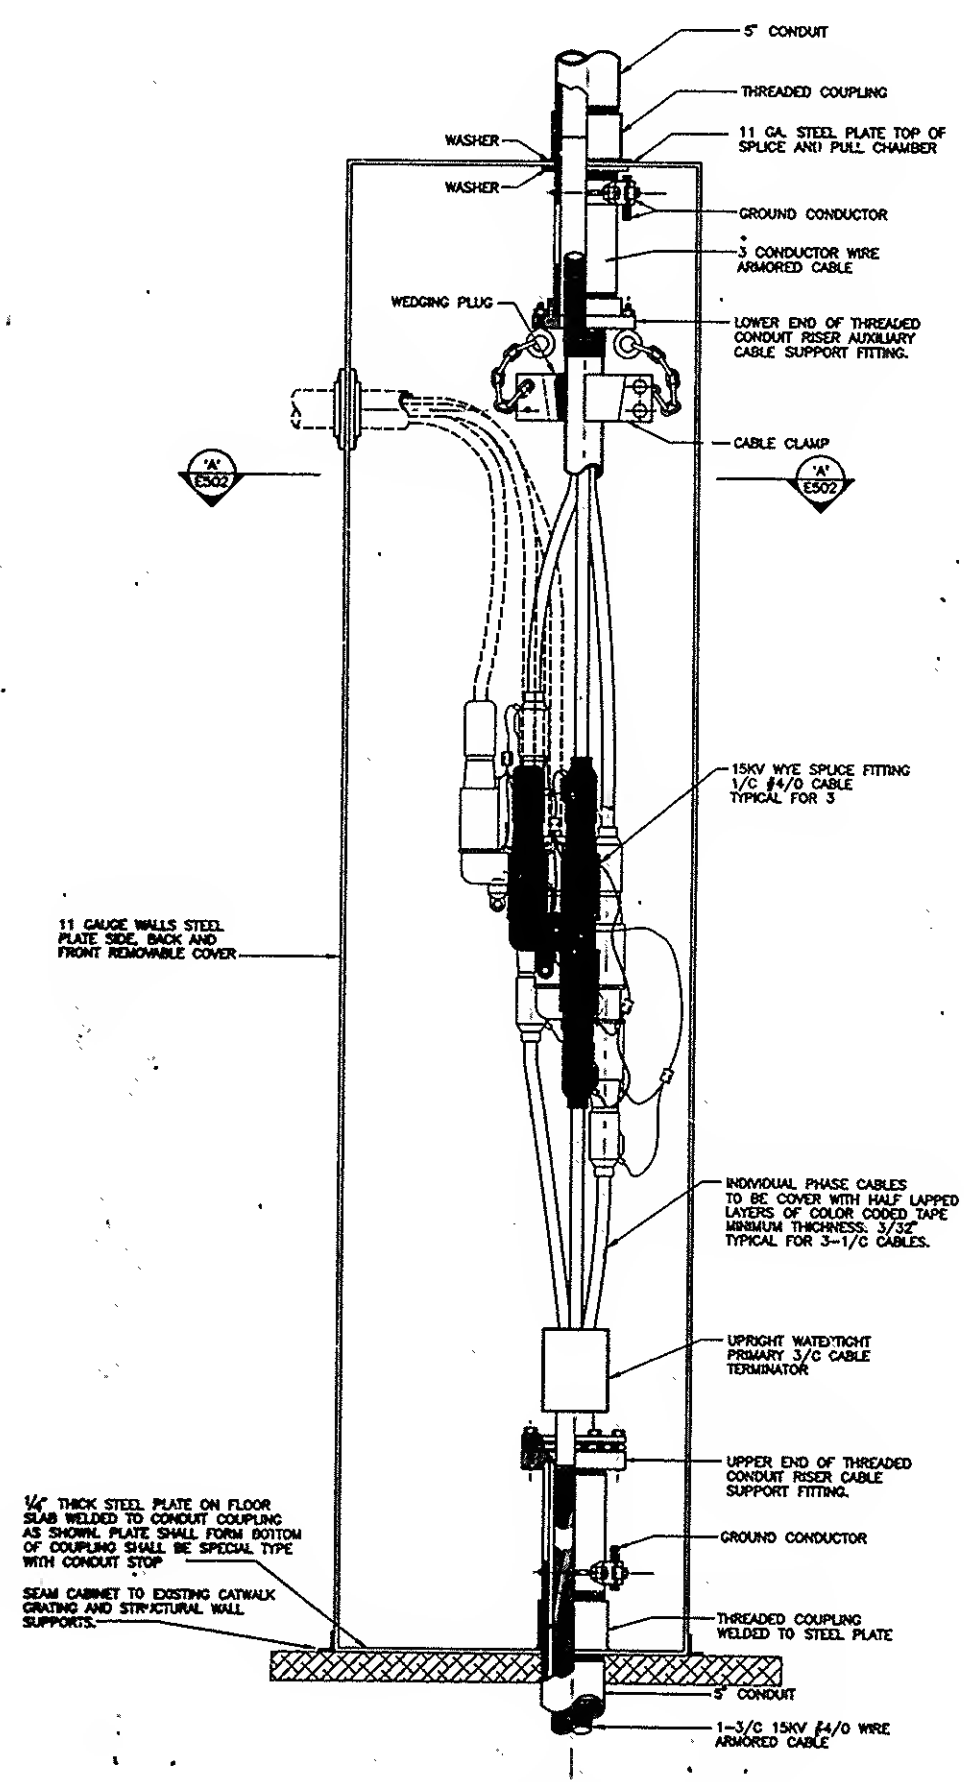

TYPICAL INSTALLATION DETAIL OF  
15KV ARMORED CABLE SUPPORT  
SPLICE AND PULL CABINET  
NO SCALE

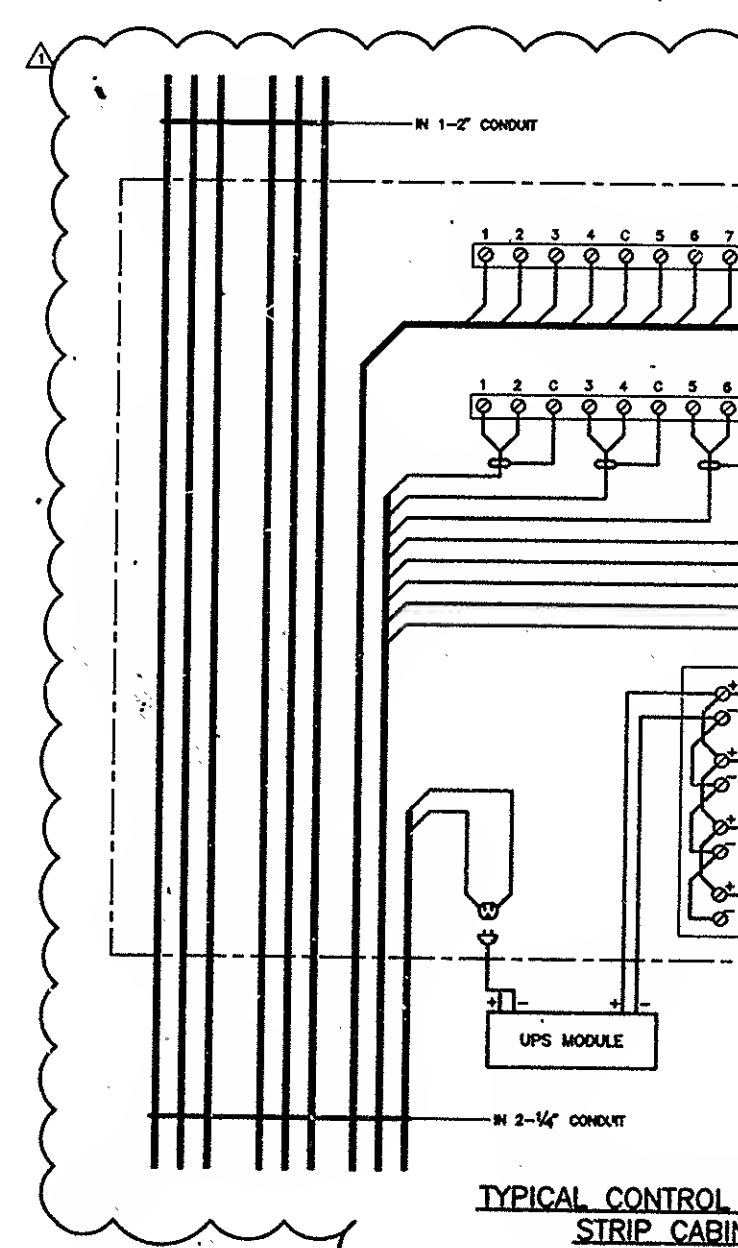

TYPICAL CONTROL  
STRIP CABINET  
NOT TO SCALE

- NOTES:
1. FOR NUMBER AND SIZE FOR CONDUIT SEE DRAWING E1-02.
  2. UPS MODULE SHALL BE LIEBERT 120WAC.
  3. UPS INSTALLATION SHALL INCLUDE WITH SLIDE RAILS OR BRACKETS AT WALL MOUNTED SHELF. MOUNT UPS STRIP CABINET AND CONNECTED TO IN THE STRIP CABINET.